


CASITA 1369
 FIRST FLOOR 5639
 SECOND FLOOR 3171
 10179

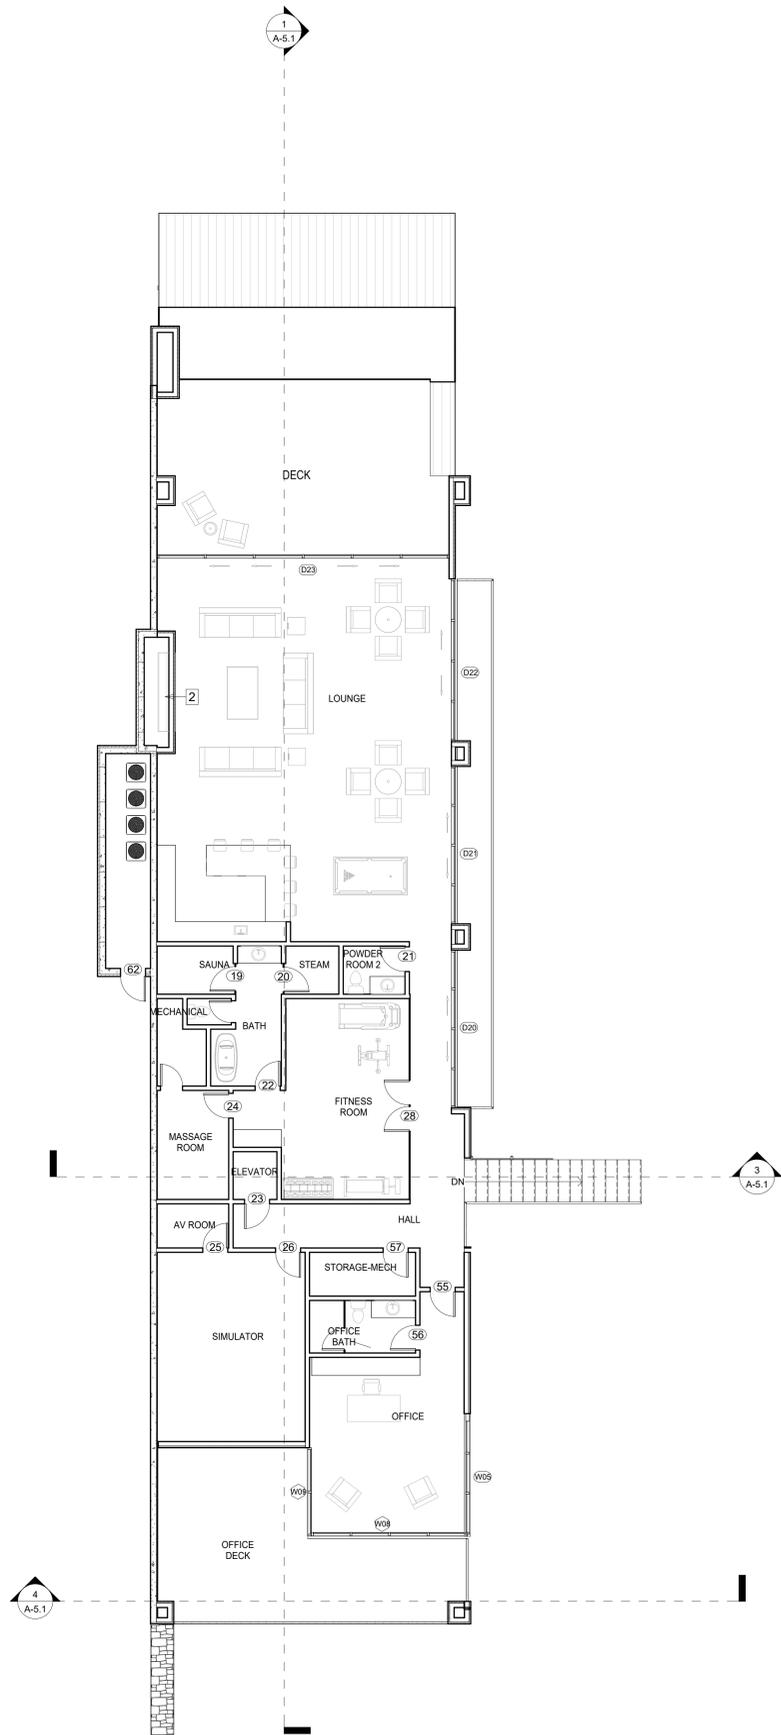

1 SECOND FLOOR PLAN
 1/8" = 1'-0"

SCHEDULES

WINDOW SCHEDULE

| Win. No. | Type | Width | Height | Sill Height | Head Height |
|----------|------|-------|--------|-------------|-------------|
|----------|------|-------|--------|-------------|-------------|

DOOR SCHEDULE

| Door No. | Type | Width | Height | Sill Height | Head Height |
|----------|------|--------|--------|-------------|-------------|
| 69 | D01 | 3'-4" | 8'-0" | 0'-0" | 8'-0" |
| 70 | D01 | 3'-4" | 8'-0" | 0'-0" | 8'-0" |
| 3 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 4 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 5 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 6 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 7 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 8 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 11 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 12 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 14 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 15 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 16 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 10 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 9 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 13 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 17 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 18 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 19 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 20 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 21 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 22 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 23 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 24 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 25 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 26 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 27 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 28 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 39 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 50 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 51 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 55 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 56 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 57 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 60 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 62 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 63 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 62 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 64 | D02 | 2'-10" | 8'-0" | 0'-0" | 8'-0" |
| 30 | D03 | 3'-0" | 8'-0" | 0'-0" | 8'-0" |
| 31 | D03 | 3'-0" | 8'-0" | 0'-0" | 8'-0" |
| 32 | D03 | 3'-0" | 8'-0" | 0'-0" | 8'-0" |
| 33 | D03 | 3'-0" | 8'-0" | 0'-0" | 8'-0" |
| 34 | D03 | 3'-0" | 8'-0" | 0'-0" | 8'-0" |
| 35 | D03 | 3'-0" | 8'-0" | 0'-0" | 8'-0" |
| 37 | D03 | 3'-0" | 8'-0" | 0'-0" | 8'-0" |
| 36 | D04 | 2'-6" | 8'-0" | 0'-0" | 8'-0" |
| 38 | D04 | 2'-6" | 8'-0" | 0'-0" | 8'-0" |
| 76 | D04 | 2'-6" | 8'-0" | 0'-0" | 8'-0" |
| 77 | D04 | 2'-6" | 8'-0" | 0'-0" | 8'-0" |
| 78 | D04 | 2'-6" | 8'-0" | 0'-0" | 8'-0" |
| 64 | D05 | 3'-0" | 7'-0" | 0'-0" | 7'-0" |
| 61 | D06 | 4'-0" | 7'-0" | 0'-0" | 7'-0" |
| 54 | D07 | 4'-6" | 7'-0" | 0'-0" | 7'-0" |
| 43 | RS01 | 18'-0" | 8'-0" | 0'-0" | 8'-0" |
| 44 | RS01 | 18'-0" | 8'-0" | 0'-0" | 8'-0" |
| 45 | RS01 | 18'-0" | 8'-0" | 0'-0" | 8'-0" |

WALL TYPE

- 2x6 INTERIOR WALL: 5/8" DRYWALL EACH SIDE AND BATT INSULATION.
- 2x6 EXTERIOR WALL STONE: 5/8" DRYWALL INTERIOR-R19 MIN. SPRAY FOAM INSULATION- STONE VENEER EXTERIOR.
- 2X6 EXTERIOR WALL : WOOD WALL VENEER. INTERIOR-R21 MIN. SPRAY FOAM 5/8" DRYWALL
- 8" CONCRETE WALL STUCCO FINISH
- 8" CONCRETE WALL STONE FINISH

FLOOR PLAN NOTES:

1. CEMENT BOARD INSTALLED PER MANUFACTURERS RECOMMENDATIONS INSTALLED AT ALL SHOWER AND TUB AREAS PER (R702.4.2). WATER RESISTANT GYP. BOARD SHALL NOT BE USED IN TUB, SHOWERS, OR AREAS ON CONTINUOUS HUMIDITY.
2. ISOKERN MANUFACTURED FIREPLACES PER ICC- ESR2316. PROVIDE OUTSIDE COMBUSTION AIR FOR INTERIOR FIREPLACES. (R1006.2) FIREPLACE DAMPERS: WHERE A LISTED DECORATIVE APPLIANCE IS INSTALLED, THE FIREPLACE DAMPER OPENING SHALL COMPLY WITH LISTED DECORATIVE APPLIANCE MANUFACTURE'S INSTALLATION INSTRUCTIONS. (G2453.1) PROVIDE A PERMANENTLY INSTALLED APPROVED DECORATIVE APPLIANCE GAS LOG SET. R1004.4.
3. ALL MECHANICAL UNITS TO BE DIRECT VENT.
4. TANK-LESS DIRECT VENT RINNAI WATER HEATER.
5. MECHANICAL ROOMS TO HAVE 5/8" TYPE X DRYWALL AT WALLS AND CEILING AND 18" NON- COMBUSTIBLE PLATFORMS FOR EQUIPMENT.
6. PROVIDE A 20 MINUTE FIRE RATED 1-3/8" SOLID DOOR, SELF-CLOSING, SELF-LATCHING, BETWEEN RESIDENCE AND GARAGE. (R302.5.1 AMEND.)
7. THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE AND ITS ATTIC AREA BY NOT LESS THAN 5/8" TYPE X GYPSUM APPLIED TO THE GARAGE SIDE.
8. ALL INTERIOR AND EXTERIOR GLAZING IN BATHROOMS MUST BE SAFETY GLAZING WHEN THE WHEN THE BOTTOM EDGE IS LESS THAN 60 PER 308.4.5' ABOVE FLOOR LEVEL. (BATHROOMS SHALL BE DEFINED AS A ROOM PROVIDED WITH A TUB OR SHOWER).
9. ALL AIR DUCTS PENETRATING SEPARATION WALL OR CEILING BETWEEN GARAGE AND LIVING AREA SHALL BE 26 GAUGE MINIMUM. 2015 IRC R302.5.2.
10. WALL CONSTRUCTION. TYPICAL EXTERIOR AND INTERIOR WALL CONSTRUCTION TO BE 2X6 STUDS @ 16" O.C., U.N.O. WALL FRAMING TO BE DONE PER STRUCT. DWGS & SPECS
11. FIRE BLOCKING SHALL BE INSTALLED AT THE LOCATIONS SPECIFIED IN 2015 IRC R302.11, INCLUDING: CONCEALED SPACES OF STUD WALLS AND PARTITIONS, FLOOR AND CEILING AT 10 FT. MAXIMUM INTERVALS BOTH VERTICALLY AND HORIZONTALLY. INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES, CONCEALED SPACE BETWEEN STAIR STRINGERS AT TOP AND BOTTOM RUN, AND AT OPENINGS AROUND VENTS, PIPES, DUCTS, AND CHIMNEYS.
12. PROVIDE NON-REMOVABLE BACKFLOW PREVENTION DEVICE ON ALL EXTERIOR HOSE BIBS. 2015 UPC 603.0 AND 603.1.
13. ALL DOORS WITH DIRECT ACCESS TO THE POOL SHALL COMPLY WITH 2015 IRC 3109.4.1.8.1.
14. ALL FOAM PLASTIC INSULATION SHALL HAVE A FLAME SPREAD INDEX OF NOT GREATER THAN 75 AND SMOKE DEVELOPED INDEX NOT GREATER THAN 450. 2015 IRC R302.6.3.
15. WALL AND CEILING FINISHES SHALL HAVE A FLAME SPREAD INDEX NOT GREATER THAN 200 AND SMOKE DEVELOPED INDEX NOT GREATER THAN 450. 2015 IRC R302.9.1, 2.9.4.
16. DRAFT STOPPING SHALL BE INSTALLED IN COMBUSTIBLE CONSTRUCTION SO CONCEALED (ATTIC AND/OR FLOOR CEILING SPACE(S) DO NOT EXCEED 1,000 SQFT. 2015 IRC R302.12.
17. WATER CLOSETS, URINALS, LAVATORIES OR BIDET SHALL NOT BE SET CLOSER THAN 15" FROM ITS CENTER TO ANY SIDE WALL PARTITION VANITY OR OTHER OBSTRUCTION, OR CLOSER THAN 30" CENTER TO CENTER BETWEEN ADJACENT FIXTURES. THERE SHALL BE AT LEAST A 21" CLEARANCE IN FRONT OF THE WATER CLOSET, URINAL, LAVATORY OR BIDET TO ANY WALL, FIXTURE OR DOOR. WATER CLOSET COMPARTMENTS SHALL NOT BE LESS THAN 30" WIDE. R307.1.
18. GYPSUM BOARD APPLIED TO A CEILING SHALL BE 1/2" WHEN FRAMING MEMBERS ARE 16" O.C. OR 5/8" WHEN FRAMING MEMBERS ARE 24" O.C. OR USE LABELED 1/2" SAG-RESISTANT GYPSUM CEILING BOARD. (TABLE R702.3.5)
19. MANUFACTURE'S INSTALLATION INSTRUCTIONS, AS REQUIRED BY THIS CODE, SHALL BE AVAILABLE ON THE JOB SITE AT THE TIME OF INSPECTION (R106.1.2) CORNER WINDOW POST SHALL BE BRAKE METAL TO MATCH WINDOW FRAME
21. MECHANICAL EQUIP.-SEE MECHANICAL PLANS
22. SES-SEE ELECTRICAL
23. WATER SERVICE
24. GAS METER LOCATION- SEE PLUMBING PLANS
25. MILLWORK-SEE INTERIORS
26. DBL OVEN
27. REFRIG.
28. FREEZER
29. RANGE HOOD
30. DISHWASHER
31. WASHER/DRYER
32. BBQ
33. DEPRESS SLAB @ SHOWER-SEE STRUCTURAL

THE JK COMPANIES
 ARCHITECTURE | CONSTRUCTION AND DEVELOPMENT | HOMES AND LAND


CONCEPTUAL RESIDENCE
 9201 E LARRY HUGHES DR, SCOTTSDALE AZ
 LONE MOUNTAIN 33 OF DESERT MOUNTAIN



EXP. 03/16/21
 Justin Kilbane

BOX 2006
 CAREFREE, AZ 85377
 (480) 225-7282
 JUSTIN@JK.STUDIO

DATE
 3/3/2026 4:09:19 PM
 SHEET NO.
 A-2.2



Scale : As indicated
FLOOR PLAN